

## Warning

D1042 series are isolated Intrinsically Safe Associated Apparatus located in Non Hazardous Locations or Class I, Division 2, Groups A, B, C, D, Temperature Code T4 and Class I, Zone 2, Group IIC, IIB, IIA Temperature Code T4 Hazardous Locations (according to ANSI/ISA 12.12.01-13, UL60079-15, CSA-C22.2 No. 213-M1987, CAN/CSA C22.2 No. 60079-15:12) within the specified operating temperature limits Tamb -20 to +60 °C, and connected to equipment with a maximum limit for AC power supply Um of 250 Vrms.

**NOTE: outputs can be paralleled to increase output power. When combining outputs, consider Safety Parameters matching with the field device and allowable Group as shown in the Safety Parameters Table and check that requirements are met.**

When installed in Class I, Division 2 or Class I, Zone 2 Hazardous Locations, the module must be mounted in supplemental enclosure meeting at least IP54 degree protection. Not to be connected to control equipment that uses or generates more than 250 Vrms or Vdc with respect to earth ground.

D1042 series must be installed, operated and maintained only by qualified personnel, in accordance to the relevant national/international installation standards (e.g. ANSI/ISA RP12.06.01 Installation of Intrinsically Safe System for Hazardous (Classified) Locations, National Electrical Code NEC ANSI/NFPA 70 Section 504 and 505, Canadian Electrical Code CEC) following the established installation rules, particular care shall be given to segregation and clear identification of I.S. conductors from non I.S. ones. De-energize power source (turn off power supply voltage) before plug or unplug the terminal blocks when installed in Hazardous Locations or unless area is known to be nonhazardous.

**Warning: substitution of components may impair Intrinsic Safety and suitability for Division 2, Zone 2.**

**Avertissement: le remplacement des composants peut dégrader la Sécurité Intrinsèque et la conformité pour Div. 2, Zone 2.**

**Explosion Hazard: to prevent ignition of flammable or combustible atmospheres, disconnect power before servicing or unless area is known to be nonhazardous.**

**Danger d'Explosion: pour prévenir une inflammation de l'atmosphère inflammable ou combustible, couper l'alimentation avant de réparer à moins de savoir que l'emplacement n'est pas dangereux.**

The enclosure provides, according to EN60529, an IP20 minimum degree of mechanical protection (or similar to NEMA Standard 250 type 1) for indoor installation, outdoor installation requires an additional enclosure with higher degree of protection (i.e. IP54 to IP65 or NEMA type 12-13) consistent with the effective operating environment of the specific installation.

Units must be protected against dirt, dust, extreme mechanical (e.g. vibration, impact and shock) and thermal stress, and casual contacts.

If enclosure needs to be cleaned use only a cloth lightly moistened by a mixture of detergent in water.

**Electrostatic Hazard: to avoid electrostatic hazard, the enclosure of D1042 must be cleaned only with a damp or antistatic cloth.**

**Danger électrostatique: pour éviter le danger électrostatique, l'enveloppe de D1042 doit être nettoyée au moyen d'un chiffon humide ou antistatique.**

Any penetration of cleaning liquid must be avoided to prevent damage to the unit.

Failure to properly installation or use of the equipment may risk to damage the unit or severe personal injury.

The unit cannot be repaired by the end user and must be returned to the manufacturer or his authorized representative. Any unauthorized modification must be avoided.

If calibration requires the use of an adjustable power supply, current meter, or voltmeter, it should be only be performed when the area is known to be nonhazardous or with equipment suitable for the area classification.

## Technical Data

**Supply:** 24 Vdc nom (21.5 to 30 Vdc) reverse polarity protected, ripple within voltage limits  $\leq 5$  Vpp.

**Current consumption @ 24 V:** 130 mA with four channels energized at nominal load, 150 mA with short circuit output.

**Power dissipation:** 2.3 W with 24 V supply voltage and four channels energized at nominal load.

**Max. power consumption:** at 30 V supply voltage and short circuit output, 4.0 W.

**Isolation (Test Voltage):** I.S. Out/In 1.5 KV; I.S. Out/Supply 1.5 KV; In/Supply 500 V.

**Input:** voltage free contact, logic level common positive or common negative or loop powered.

**Trip voltage levels:** OFF status  $\leq 1.0$  V, ON status  $\geq 6.0$  V (maximum 30 V).

**Current consumption @ 24 V:** 3 mA ( $\approx 10$  K $\Omega$  input impedance).

**Output:** 22 mA at 14.5 V per channel (20.5 V no load, 273  $\Omega$  series resistance).

**Short circuit current:**  $\geq 24$  mA per channel (26 mA typical).

**Response time:** 20 ms (power up in 600 ms typical in loop powered mode).

**Environmental conditions: Operating:** temperature limits -20 to + 60 °C, relative humidity max 90 % non condensing, up to 35 °C.

**Storage:** temperature limits - 45 to + 80 °C.

**Safety Description:**

for use in Class I, Division 2, Groups A, B, C, D, Temperature Code T4; Class I, Zone 2, AEx nA [ia] IIC T4 and Class I, Zone 2, Ex nA [ia] IIC T4 Hazardous Locations.

Provides intrinsically safe circuits for use in Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1 and Class I, Zone 0, Group IIC Hazardous Locations.

**Approvals:** UL & C-UL E222308 conforms to UL 913 (Div. 1, 8th Ed., Rev. 2013-12-06), UL 60079-0 (General, All Zones, 6th Ed.), UL 60079-11 (Intrinsic Safety "I" Zones 0 & 1, 6th Ed.), UL 60079-15 ("n" Zone 2, 4th Ed.), ANSI/ISA 12.12.01-2013 (Div. 2), UL 61010-1 (3rd Ed., Rev. 2012-05-11) for UL and CAN/CSA-C22.2 No. 157-92 (Reaffirmed 2012, Div. 1), CAN CSA-C22.2 No. 60079-0:11 (General, All Zones), CAN/CSA-C22.2 No. 60079-11:14 (Intrinsic Safety "I" Zones 0 & 1), CSA-C22.2 No. 213-M1987 (R2013, Div. 2), CAN/CSA-C22.2 No. 60079-15:12 ("n" Zone 2), CAN/CSA-C22.2 No. 61010-1-12 (3rd Ed.) for C-UL.

**Mounting:** T35 DIN Rail according to EN50022.


**Weight:** about 130 g.

**Connection:** by polarized plug-in disconnect screw terminal blocks to accommodate terminations up to 2.5 mm<sup>2</sup>.

**Location:** Non Hazardous Locations or Class I, Division 2, Groups A, B, C, D Temperature Code T4 and Class I, Zone 2, Group IIC, IIB, IIA T4 installation.

**Protection class:** IP 20.

**Dimensions:** Width 22.5 mm, Depth 99 mm, Height 114.5 mm.

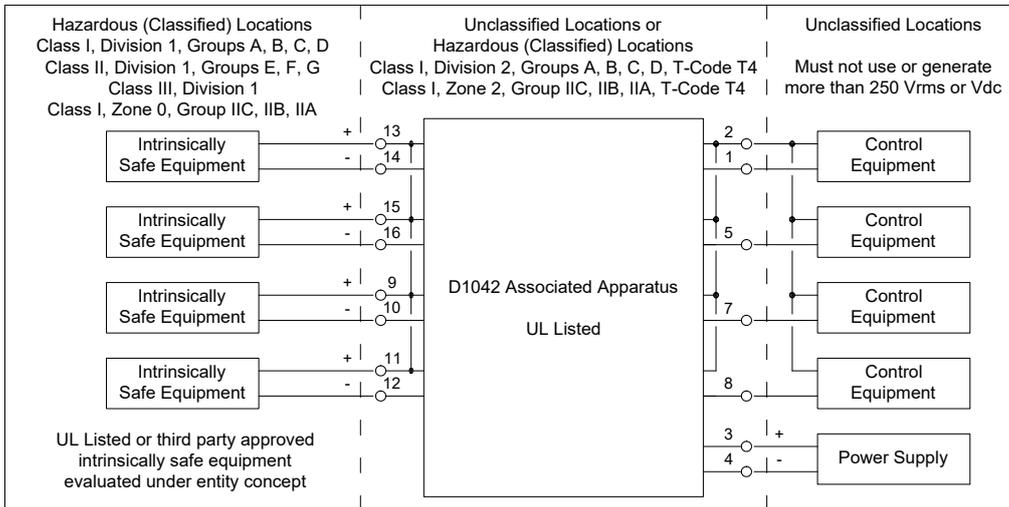

**NOTE:**  
when installed in Class I, Division 2 or Class I, Zone 2 Hazardous Locations, the module must be mounted in supplemental enclosure meeting at least IP54 degree protection.

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

Where multiple circuits extend from the same piece of associated apparatus, they must be installed in separate cables or in one cable having suitable insulation. Refer to Article 504.30(B) of the National Electrical Code (ANSI/NFPA 70) and Instrument Society of America Recommended Practice ISA RP12.6 for installing intrinsically safe equipment.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.


This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1042 Terminals		Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
Ch1	13 - 14	$U_o / V_{oc} = 23.6 \text{ V}$	$\leq$	$U_i / V_{max}$
Ch2	15 - 16	$I_o / I_{sc} = 88.2 \text{ mA}$	$\leq$	$I_i / I_{max}$
Ch3	9 - 10			
Ch4	11 - 12	$P_o / P_0 = 519 \text{ mW}$	$\leq$	$P_i / P_i$

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1042 Terminals		D1042 Associated Apparatus Parameters Zones (Divisions)		Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
Ch1	13 - 14	$C_o / C_a = 130 \text{ nF}$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	$\geq$	$C_i / C_i \text{ device} + C \text{ cable}$
		$C_o / C_a = 970 \text{ nF}$			
		$C_o / C_a = 3.5 \mu\text{F}$			
Ch2	15 - 16	$L_o / L_a = 4.5 \text{ mH}$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	$\geq$	$L_i / L_i \text{ device} + L \text{ cable}$
		$L_o / L_a = 18.2 \text{ mH}$			
Ch3	9 - 10	$L_o / L_a = 36.5 \text{ mH}$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	$\geq$	$L_i / R_i \text{ device and}$ $L \text{ cable} / R \text{ cable}$
Ch4	11 - 12	$L_o / L_a = 18.2 \text{ mH}$			
		$L_o / R_o = 68.6 \mu\text{H}/\Omega$	IIC (A, B) IIB (C) IIA (D) (E, F, G)	$\geq$	$L_i / R_i \text{ device and}$ $L \text{ cable} / R \text{ cable}$
		$L_o / R_o = 274.4 \mu\text{H}/\Omega$			
		$L_o / R_o = 548.9 \mu\text{H}/\Omega$			
		$L_o / R_o = 274.4 \mu\text{H}/\Omega$			

**NOTE:** for installations in which both the  $C_i$  and  $L_i$  of the Intrinsically Safe apparatus exceed 1 % of the  $C_o$  and  $L_o$  parameters of the Associated Apparatus (excluding the cable), then 50 % of  $C_o$  and  $L_o$  parameters are applicable and shall not be exceeded (50 % of the  $C_o$  and  $L_o$  become the limits which must include the cable such that  $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$  and  $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$ ).  
The reduced capacitance of the external circuit (including cable) shall not be greater than 1uF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B).  
Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table.  
If the cable parameters are unknown, the following may be used:  
Capacitance 60pF per foot (180pF per meter),  
Inductance 0.20μH per foot (0.60μH per meter).

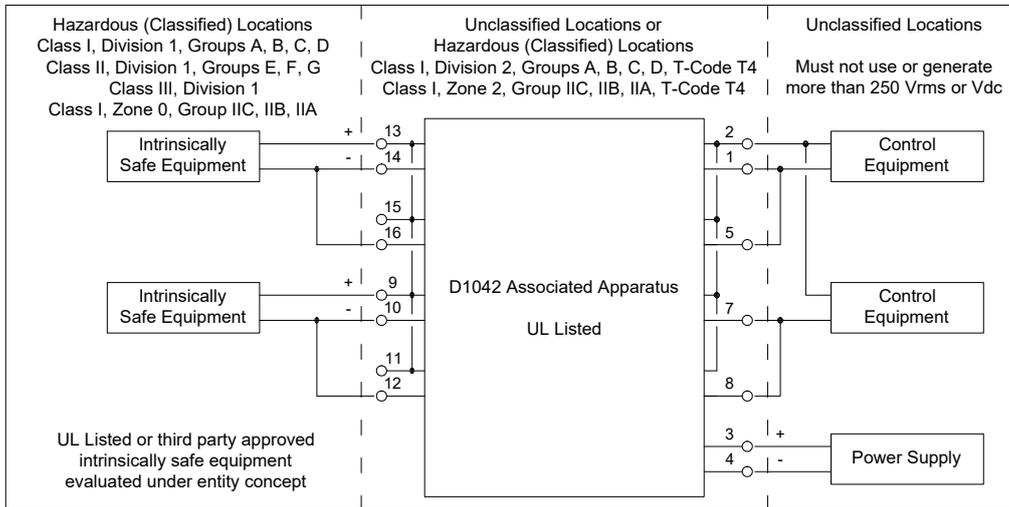

**NOTE:**  
when installed in Class I, Division 2 or Class I, Zone 2 Hazardous Locations, the module must be mounted in supplemental enclosure meeting at least IP54 degree protection.

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

Where multiple circuits extend from the same piece of associated apparatus, they must be installed in separate cables or in one cable having suitable insulation. Refer to Article 504.30(B) of the National Electrical Code (ANSI/NFPA 70) and Instrument Society of America Recommended Practice ISA RP12.6 for installing intrinsically safe equipment.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.

This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1042 Terminals		Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
Ch1	13 - 14 (with 14 - 16 shorted)	$U_o / V_{oc} = 23.6 \text{ V}$	$\leq$	$U_i / V_{max}$
		$I_o / I_{sc} = 176.4 \text{ mA}$	$\leq$	$I_i / I_{max}$
Ch2	9 - 10 (with 10 - 12 shorted)	$P_o / P_o = 1038 \text{ mW}$	$\leq$	$P_i / P_i$

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1042 Terminals		D1042 Associated Apparatus Parameters Zones (Divisions)		Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
Ch1 Ch2	13 - 14 (with 14 - 16 shorted) 9 - 10 (with 10 - 12 shorted)	$C_o / C_a = 130 \text{ nF}$	IIC (A, B)	$\geq$	$C_i / C_i \text{ device} + C \text{ cable}$
		$C_o / C_a = 970 \text{ nF}$	IIB (C)		
		$C_o / C_a = 3.5 \mu\text{F}$	IIA (D)		
		$C_o / C_a = 970 \text{ nF}$	(E, F, G)		
		$L_o / L_a = 1.1 \text{ mH}$	IIC (A, B)	$\geq$	$L_i / L_i \text{ device} + L \text{ cable}$
		$L_o / L_a = 4.5 \text{ mH}$	IIB (C)		
		$L_o / L_a = 9.1 \text{ mH}$	IIA (D)		
		$L_o / L_a = 4.5 \text{ mH}$	(E, F, G)		
		$L_o / R_o = 34.3 \mu\text{H}/\Omega$	IIC (A, B)	$\geq$	$L_i / R_i \text{ device and } L \text{ cable} / R \text{ cable}$
		$L_o / R_o = 137.2 \mu\text{H}/\Omega$	IIB (C)		
		$L_o / R_o = 274.4 \mu\text{H}/\Omega$	IIA (D)		
		$L_o / R_o = 137.2 \mu\text{H}/\Omega$	(E, F, G)		


**NOTE:** for installations in which both the  $C_i$  and  $L_i$  of the Intrinsically Safe apparatus exceed 1 % of the  $C_o$  and  $L_o$  parameters of the Associated Apparatus (excluding the cable), then 50 % of  $C_o$  and  $L_o$  parameters are applicable and shall not be exceeded (50 % of the  $C_o$  and  $L_o$  become the limits which must include the cable such that  $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$  and  $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$ ).

The reduced capacitance of the external circuit (including cable) shall not be greater than 1uF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B).

Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table.

If the cable parameters are unknown, the following may be used:

Capacitance 60pF per foot (180pF per meter), Inductance 0.20μH per foot (0.60μH per meter).

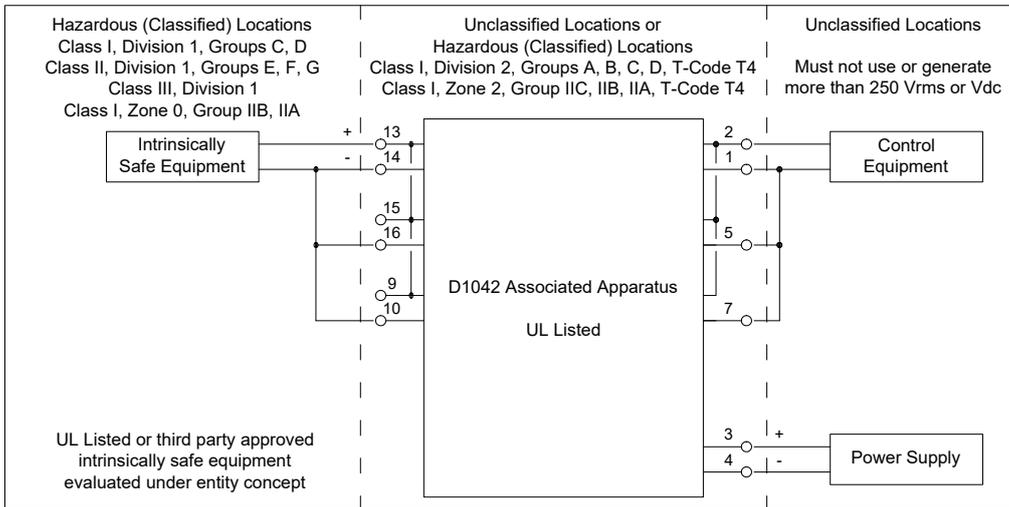

**NOTE:**  
when installed in Class I, Division 2 or Class I, Zone 2 Hazardous Locations, the module must be mounted in supplemental enclosure meeting at least IP54 degree protection.

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.


This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1042 Terminals	Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
13 - 14 (with 14 - 16 - 10 shorted)	$U_o / V_{oc} = 23.6 \text{ V}$	$\leq$	$U_i / V_{max}$
	$I_o / I_{sc} = 264.6 \text{ mA}$	$\leq$	$I_i / I_{max}$
	$P_o / P_o = 1556 \text{ mW}$	$\leq$	$P_i / P_i$

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1042 Terminals	D1042 Associated Apparatus Parameters Zones (Divisions)	Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
13 - 14 (with 14 - 16 - 10 shorted)	$C_o / C_a = 970 \text{ nF}$ $C_o / C_a = 3.5 \text{ }\mu\text{F}$ $C_o / C_a = 970 \text{ nF}$	IIB (C) IIA (D) (E, F, G)	$\geq$ $C_i / C_i \text{ device} + C \text{ cable}$
	$L_o / L_a = 2 \text{ mH}$ $L_o / L_a = 4 \text{ mH}$ $L_o / L_a = 2 \text{ mH}$	IIB (C) IIA (D) (E, F, G)	$\geq$ $L_i / L_i \text{ device} + L \text{ cable}$
	$L_o / R_o = 91.4 \text{ }\mu\text{H}/\Omega$ $L_o / R_o = 182.9 \text{ }\mu\text{H}/\Omega$ $L_o / R_o = 91.4 \text{ }\mu\text{H}/\Omega$	IIB (C) IIA (D) (E, F, G)	$\geq$ $L_i / R_i \text{ device and}$ $L \text{ cable} / R \text{ cable}$

**NOTE: for installations in which both the  $C_i$  and  $L_i$  of the Intrinsically Safe apparatus exceed 1 % of the  $C_o$  and  $L_o$  parameters of the Associated Apparatus (excluding the cable), then 50 % of  $C_o$  and  $L_o$  parameters are applicable and shall not be exceeded (50 % of the  $C_o$  and  $L_o$  become the limits which must include the cable such that  $C_i \text{ device} + C \text{ cable} \leq 50 \%$  of  $C_o$  and  $L_i \text{ device} + L \text{ cable} \leq 50 \%$  of  $L_o$ ).**  
 The reduced capacitance of the external circuit (including cable) shall not be greater than 1uF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B).  
 Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table.  
 If the cable parameters are unknown, the following may be used:  
 Capacitance 60pF per foot (180pF per meter), Inductance 0.20uH per foot (0.60uH per meter).

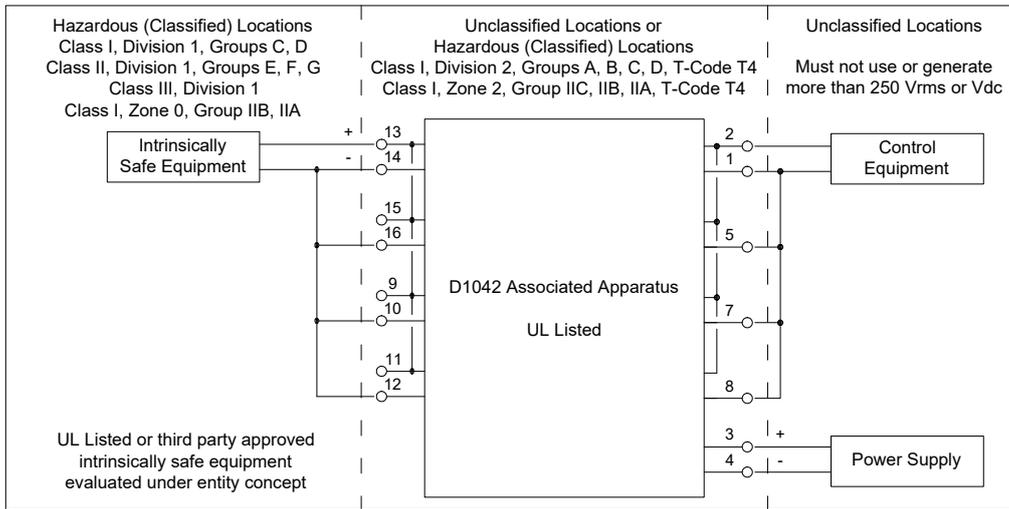

**NOTE:** when installed in Class I, Division 2 or Class I, Zone 2 Hazardous Locations, the module must be mounted in supplemental enclosure meeting at least IP54 degree protection.

This associated apparatus may also be connected to simple apparatus as defined in Article 504.2 and installed and temperature classified in accordance with article 504.10(B) of the National Electrical Code (ANSI/NFPA 70), or other local codes, as applicable.

This associated apparatus has not been evaluated for use in combination with another associated apparatus.

This associated apparatus provides galvanically isolated intrinsically safe circuits.

D1042 Terminals	Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
13 - 14 (with 14 - 16 - 10 - 12 shorted)	$U_o / V_{oc} = 23.6 V$	$\leq$	$U_i / V_{max}$
	$I_o / I_{sc} = 352.8 mA$	$\leq$	$I_i / I_{max}$
	$P_o / P_o = 2073 mW$	$\leq$	$P_i / P_i$

The output current of this associated apparatus is limited by a resistor such that the output voltage-current plot is straight line drawn between open-circuit voltage and short-circuit current.

D1042 Terminals	D1042 Associated Apparatus Parameters Zones (Divisions)		Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
13 - 14 (with 14 - 16 - 10 - 12 shorted)	$C_o / C_a = 970 nF$	IIB (C) IIA (D) (E, F, G)	$\geq$	$C_i / C_i \text{ device} + C \text{ cable}$
	$C_o / C_a = 3.5 \mu F$			
	$C_o / C_a = 970 nF$			
13 - 14 (with 14 - 16 - 10 - 12 shorted)	$L_o / L_a = 1.1 mH$	IIB (C) IIA (D) (E, F, G)	$\geq$	$L_i / L_i \text{ device} + L \text{ cable}$
	$L_o / L_a = 2.2 mH$			
	$L_o / L_a = 1.1 mH$			
13 - 14 (with 14 - 16 - 10 - 12 shorted)	$L_o / R_o = 68.6 \mu H/\Omega$	IIB (C) IIA (D) (E, F, G)	$\geq$	$L_i / R_i \text{ device and } L \text{ cable} / R \text{ cable}$
	$L_o / R_o = 137.2 \mu H/\Omega$			
	$L_o / R_o = 68.6 \mu H/\Omega$			

**NOTE:** for installations in which both the  $C_i$  and  $L_i$  of the Intrinsically Safe apparatus exceed 1 % of the  $C_o$  and  $L_o$  parameters of the Associated Apparatus (excluding the cable), then 50 % of  $C_o$  and  $L_o$  parameters are applicable and shall not be exceeded (50 % of the  $C_o$  and  $L_o$  become the limits which must include the cable such that  $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$  and  $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$ ).  
 The reduced capacitance of the external circuit (including cable) shall not be greater than 1uF for Groups I, IIA (Group D), IIB (Group C), and 600nF for Group IIC (Group A and B).  
 Capacitance and inductance of the field wiring from the intrinsically safe equipment to the associated apparatus shall be calculated and must be included in the system calculations as shown in the entity parameters table.  
 If the cable parameters are unknown, the following may be used:  
 Capacitance 60pF per foot (180pF per meter), Inductance 0.20uH per foot (0.60uH per meter).